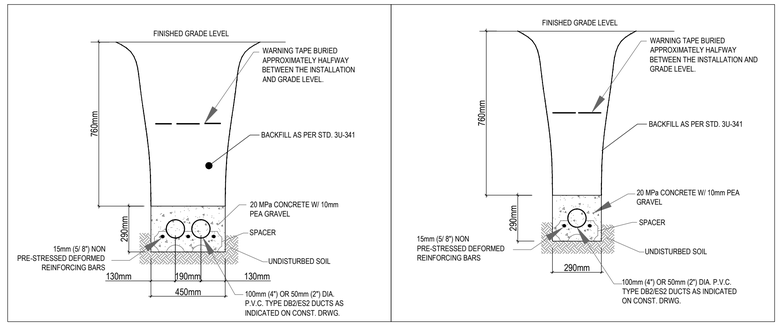

TWO DUCT TYPICAL ARRANGEMENT ENCASED IN CONCRETE DIAGRAM B4-4 DETAIL 2

TELEPHONE DUCT BANKS DETAIL (TYP.)

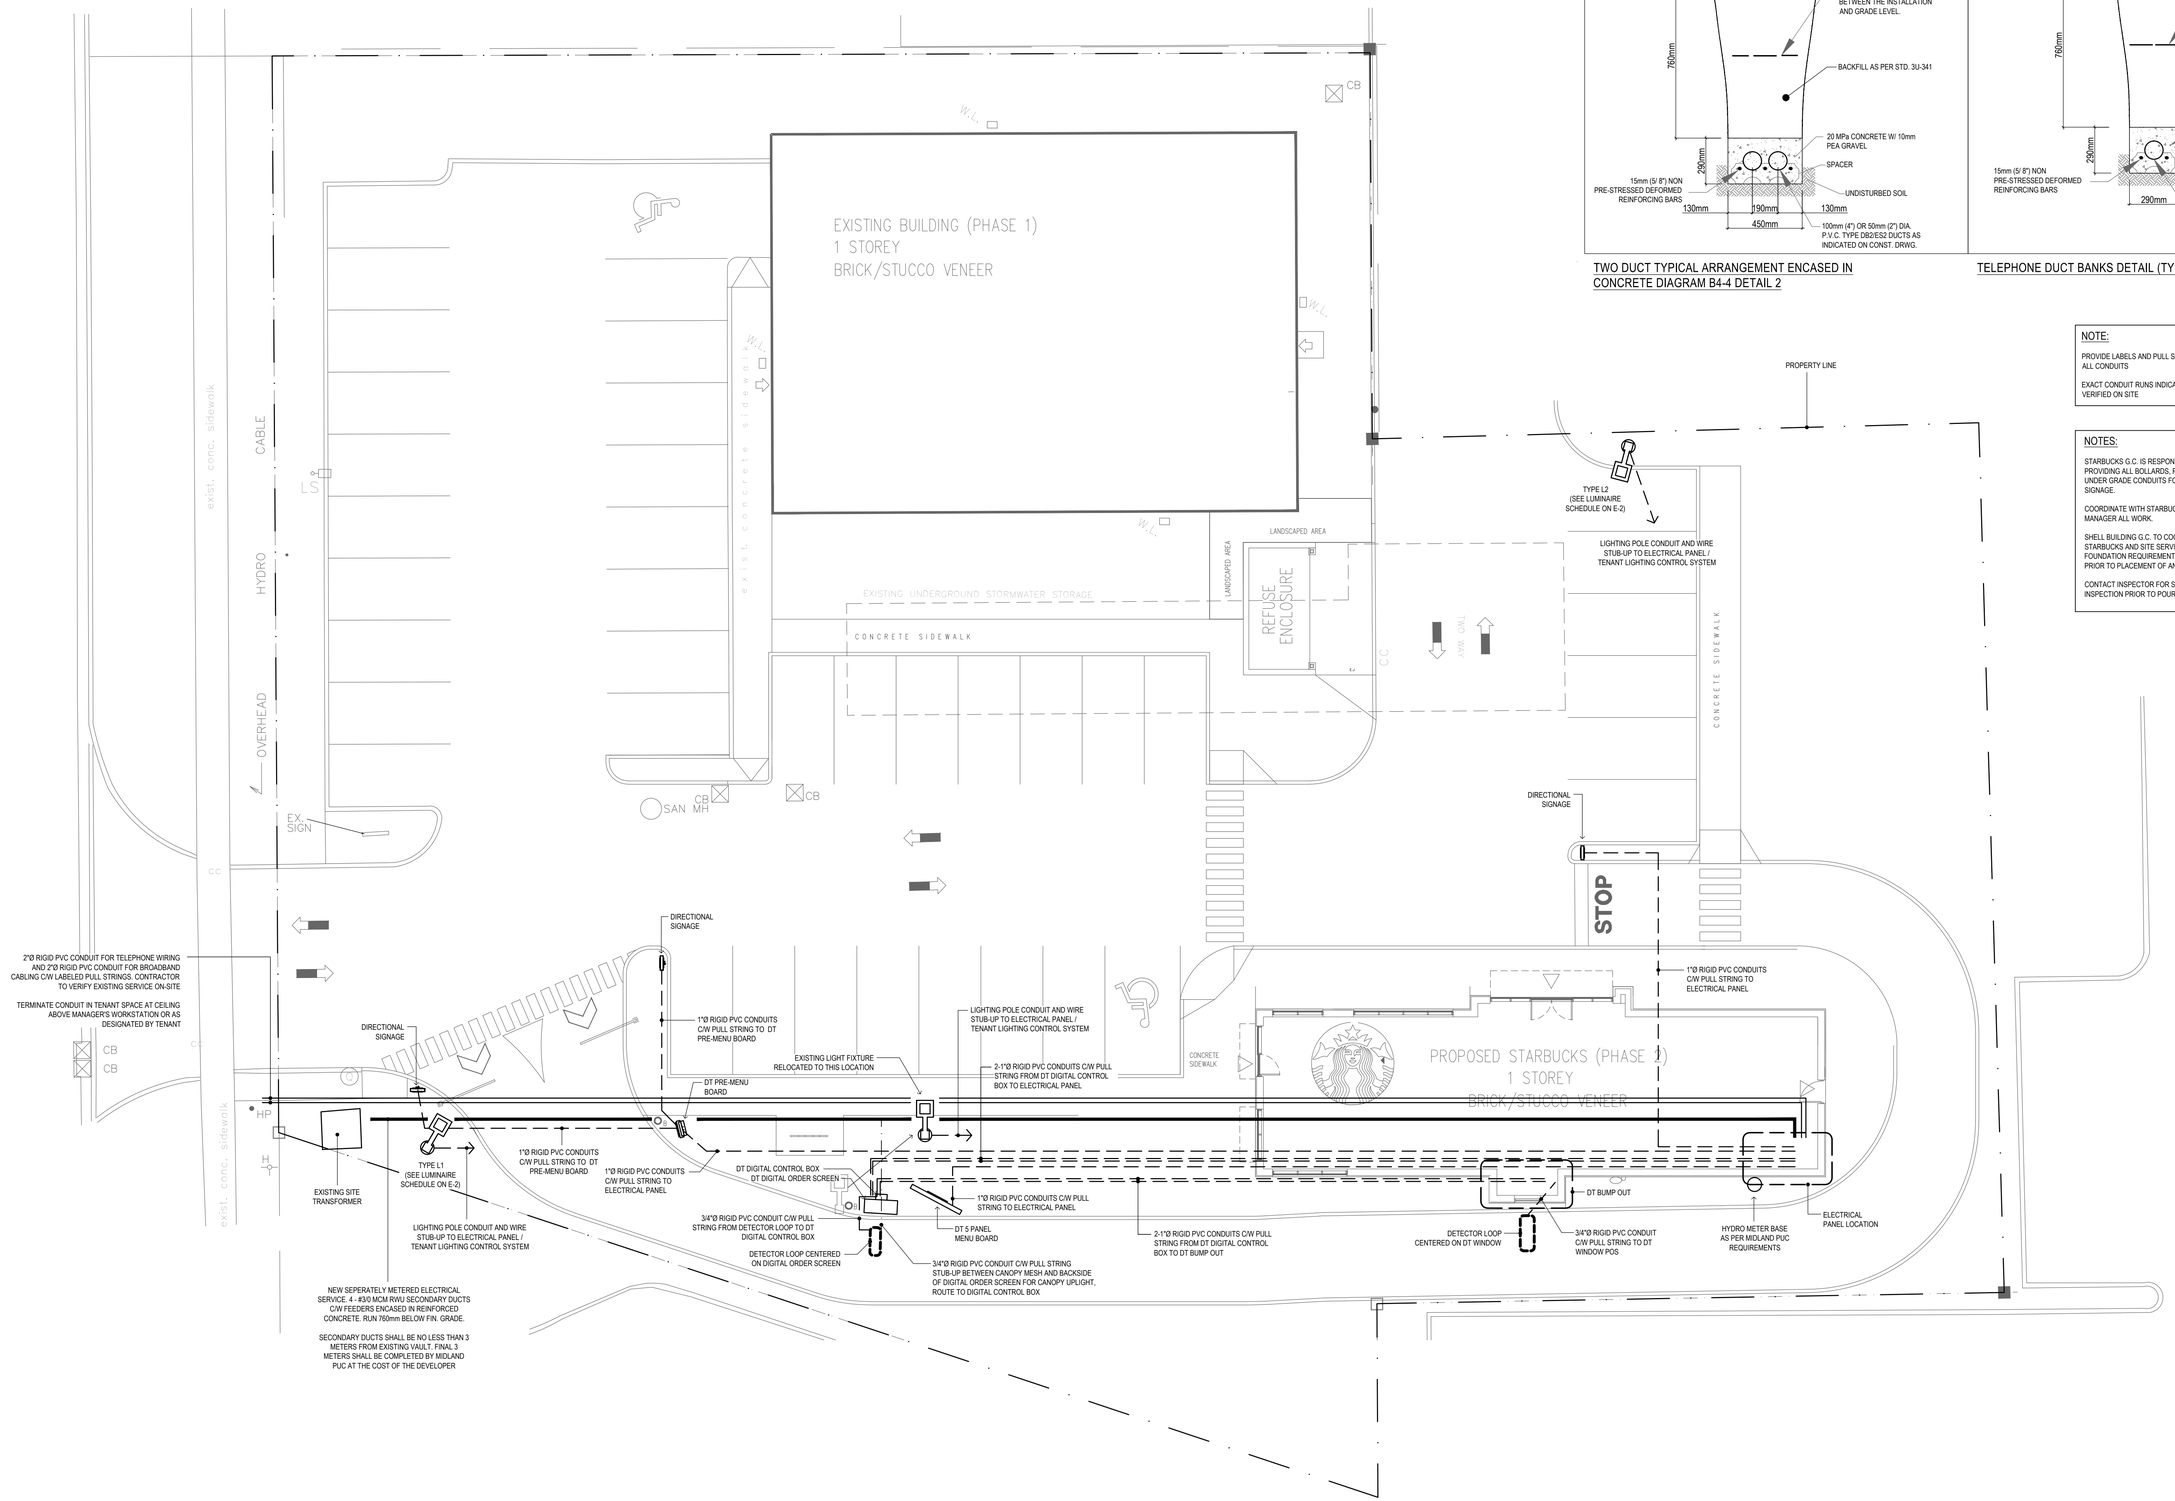

NOTE:

PROVIDE LABELS AND PULL STRINGS FOR ALL CONDUITS

EXACT CONDUIT RUNS INDICATED TO BE VERIFIED ON SITE

NOTES:

STARBUCKS G.C. IS RESPONSIBLE FOR PROVIDING ALL BOLLARDS, FOOTINGS AND UNDER GRADE CONDUITS FOR DRIVE-THRU SIGNAGE.

COORDINATE WITH STARBUCKS CONSTRUCTION MANAGER ALL WORK.

SHELL BUILDING G.C. TO COORDINATE WITH STARBUCKS AND SITE SERVICES G.C. ALL FOUNDATION REQUIREMENTS FOR SIGNAGE PRIOR TO PLACEMENT OF ANY CONCRETE

CONTACT INSPECTOR FOR SIGN FOOTING INSPECTION PRIOR TO POURING CONCRETE.

REVISIONS

NO.	DATE	DESCRIPTION
1		
2		
3		
2		
1	MAR 2020	ISSUED FOR PERMIT.
NO.	DATE	TO

ISSUED

DESIGNER:

GAC ENGINEERING SERVICES INC.
695 MARKHAM RD UNIT 12
TORONTO, ON M1H 2A5
OFFICE No. - (647) 748-5366
CELL No. - (416) 710-8274
gac.engineering@yahoo.ca

LICENSED PROFESSIONAL ENGINEER
G.A. CORREROS
100017653
MAR-13-20
PROVINCE OF ONTARIO

DRAWING NOTES:

1. THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY DIMENSIONS ON SITE AND REPORT ERRORS AND OMISSIONS.
2. DRAWINGS MUST NOT BE SCALED. DRAWINGS ARE DIAGRAMMATIC CONCEPT OF THE DESIGN.
3. CONTRACTOR TO SUBMIT SHOP DRAWINGS FOR CONSISTENCY WITH THE INTENT OF THE DRAWINGS AND SPECIFICATIONS.

CLIENT:

PROJECT TITLE:
PROPOSED SHELL BUILDING
9281 COUNTY RD. 93
TOWN OF MIDLAND, ONTARIO

DRAWING TITLE:
ELECTRICAL SITE PLAN

DRAWN BY: A. C.

CHECKED BY: G. C.

SCALE: 3/32" = 1'-0"

DATE: MARCH 2020

DRAWING NO: E-1

PROJECT NO: 020001