

SCALE: 1/16" = 1'-0"

PHASE 3 SCOPE OF WORKS 1. ALL LIGHTING FIXTURES MARKED "PHASE 2" ARE

EXISTING & TO REMAIN. 2. PROPOSED "PHASE 3" LIGHTING FIXTURES: -TYPE L3B -QUANTITY: 5 -LOCATION: BUILDING C

LUMINAIRE SCHEDULE											
TYPE	MANUFACTURER	DESCRIPTION	MODEL NUMBER	AVERAGE WATTAGE	LUMEN OUTPUT	LIGHT LOSS FACTOR	ССТ	DISTRIBUTION TYPE	QUANTITY	MOUNTING HEIGHT	DEVELOPMENT PHASE
L1	CREE	NOCTURA SERIES LED AREA LUMINAIRES	NTA-A-NM-T3-35L-40K-UL-BZ	230 W	35,000 lm	0.80	40K	3	2	20 FT	2
L2	CREE	NOCTURA SERIES LED AREA LUMINAIRES	NTA-A-NM-T4-19L-40K-UL-BZ	130 W	19,000 lm	0.80	40K	4	1	20 FT	2
L3A	CREE (SEE NOTE)	C-LITE SERIES LED WALL MOUNT CYLINDER LUMINAIRES (SEE NOTE)	C-WM-A-WLCY-6L-40K (SEE NOTE)	22 W	600 lm	0.80	40K	-	16	8-9 FT	2
L3B	CREE (SEE NOTE)	C-LITE SERIES LED WALL MOUNT CYLINDER LUMINAIRES (SEE NOTE)	C-WM-A-WLCY-6L-40K (SEE NOTE)	22 W	600 lm	0.80	40K	-	5	9 FT	3
L4	CREE	NOCTURA SERIES LED WALL MOUNT LUMINAIRES	NTW-A-WM-T3-7L-40K-UL-BZ	46 W	7,000 lm	0.80	40K	3	1	10 FT	2
FOUIP	FOUIPMENT AS LISTED OR FOUIVALENT										

EQUIPMENT AS LISTED L3A & B LED WALL PACH L4 AS SECURITY LIGHT

STATISTICS						
NAME	PARAMETER	MIN	MAX	AVERAGE		
Calculation surface 1	Perpendicular illuminance	0.01 fc	17.82 fc	1.8 fc		


THIS DRAWING INDICATES ALL PROPOSED OUTDOOR LIGHTING FIXTURES FOR THIS PROPOSED DEVELOPMENT. THE LIGHTING DESIGN IS IN ACCORDANCE WITH THE APPLICABLE LIGHTING ZONE AS ESTABLISHED BY THE PLANNING DEPARTMENT AND DESIGNED WITH AN AVERAGE TO MINIMUM RATIO IN ACCORDANCE WITH THE ILLUMINATING ENGINEERING SOCIETY GUIDELINES. THIS LIGHTING DESIGN WILL NOT CREATE ANY OBJECTIONABLE GLARE FOR ADJACENT PROPERTIES.


> GIL A. COFREROS SIGNATURE OF QUALIFIED DESIGNER

E)			MINAIRES DTE)	C-WM-A-WLCY-6L-40K (SEE NOTE)	22 W	600 lm	0.80	40K	-	16	8-9 FT	
·E)	C-LITE SERIES LED WALL MOUNT CYLINDER LUMINAIRES (SEE NOTE)		MINAIRES	C-WM-A-WLCY-6L-40K (SEE NOTE)	22 W	600 lm	0.80	40K	-	5	9 FT	
	NOCTURA SERIES LED WALL MOUNT LUMINAIRES			NTW-A-WM-T3-7L-40K-UL-BZ	46 W	7,000 lm	0.80	40K	3	1	10 FT	
ED OR EQUIVALENT. ACKS BY ETLIN-DANIELS (REFER TO ARCH. FOR MODEL), AS LISTED ONLY FOR CALCULATION PURPOSE HT, PROVIDE CONTROL TO TENANT'S SPACE, MINIMUM 5000 LUMENS												
STATISTICS						TES:						
ETER	MIN	MAX	AVERAGE	 ALL CONCRETE IN BASE SHALL BE VIBRATED. TOP OF FOUNDATION SHALL BE TRULY LEVEL. CONCRETE GRADE SHALL BE 32 MPa CLASS 'C2" 								
dicular ance	0.01 fc	17.82 fc	1.8 fc	MINIMUM OF 2 SLEEVES REQUIRED FOR EACH CONCRETE FOUNDATION UNLESS OTHERWISE SHOWN. CONTRACTOR TO VERIFY OPENING SIZE IN BASE PLATE PRIOR SETTING.								
						CONDUIT SL SUBJECT TO	.EEVES.) SOIL CONDITI	ONS.				


. BASES FOR LIGHTING STANDARD SHALL BE PROVIDED BY DIV. 16. 8. DIVISION 16 SHALL INCLUDE IN CONTRACT COST FOR HIRING OF STRUCTURAL ENGINEER WHO SHALL REVIEW AND APPROVE SIZE OF CONCRETE BASES FOR PARKING LOT LIGHTING STANDARDS PRIOR TO THEIR


NOTE: FACTORY SUPPLIED TEMPLATE MUST BE USED WHEN SETTING ANCHOR BOLTS. EMCO LIGHTING WILL NOT HONOR ANY CLAIM FOR INCORRECT ANCHORAGE PLACEMENT FROM FAILURE TO USE FACTORY SUPPLIED TEMPLATES.

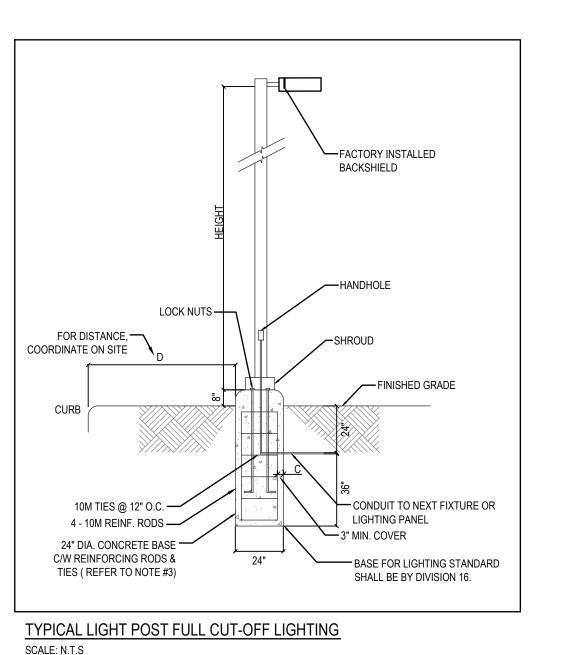

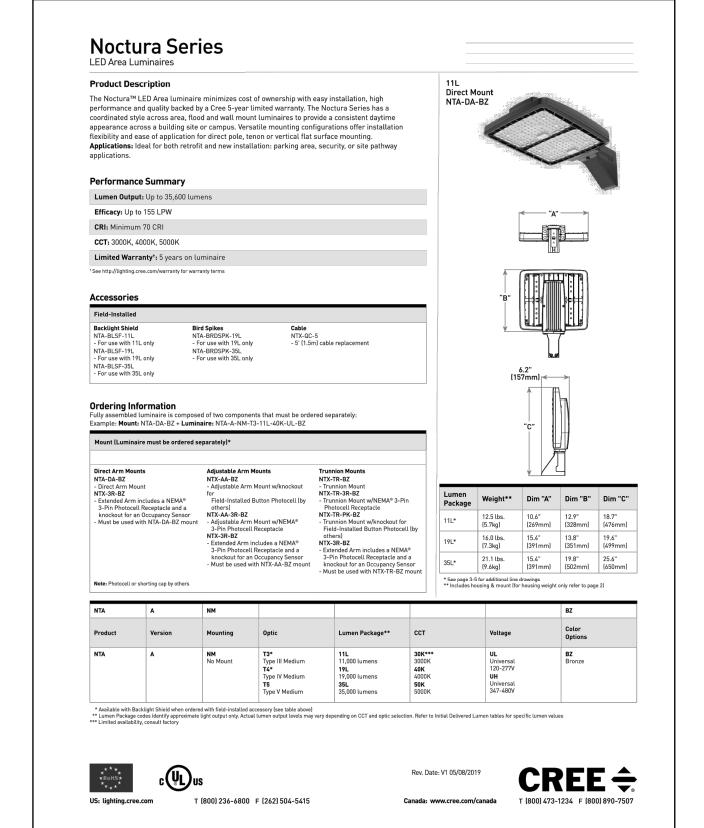


TYPE 1 & 2 LUMINAIRE

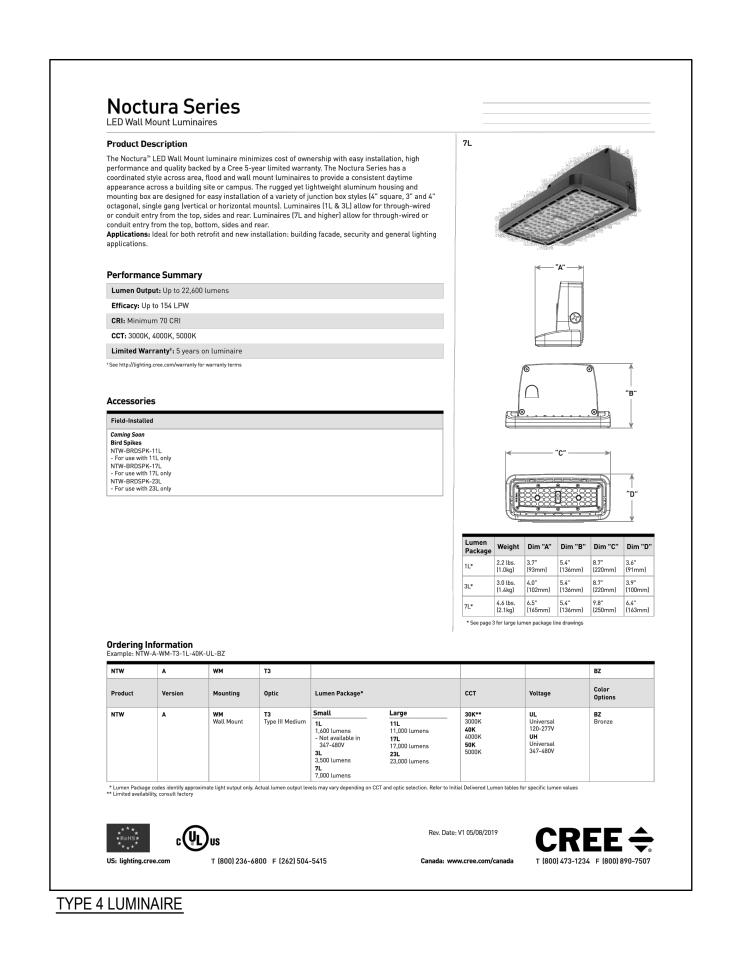

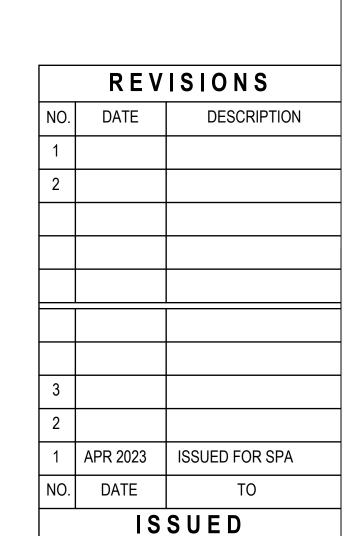



DESIGNER: GAC ENGINEERING SERVICES INC. 1080 TAPSCOTT RD UNIT 18 TORONTO, ON M1X 1E7 OFFICE No. - (416) 292-0527 CELL No. - (416) 710-8274



DRAWING NOTES:

- THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY DIMENSIONS ON SITE AND REPORT ERRORS AND OMISSIONS. DRAWINGS MUST NOT BE SCALED. DRAWINGS
- ARE DIAGRAMMATIC CONCEPT OF THE DESIGN. CONTRACTOR TO SUBMIT SHOP DRAWINGS FOR CONSISTENCY WITH THE INTENT OF THE DRAWINGS AND SPECIFICATIONS.

CLIENT:

PROJECT TITLE: PROPOSED PHASE 3 DEVELOPMENT - BUILDING C 9281 COUNTY RD. 93 TOWN OF MIDLAND, ONTARIO

DRAWING TITLE: PHOTOMETRIC PLAN

DRAWN BY:	DRAWING NO:
A. C.	
CHECKED BY:	
G. C.	
SCALE:	
1/16" = 1'-0"	
DATE:	
APRIL 2023	
PROJECT NO:	023023